


WIRING DIAGRAM SUBMITTAL Simplex VFD Booster Schematic

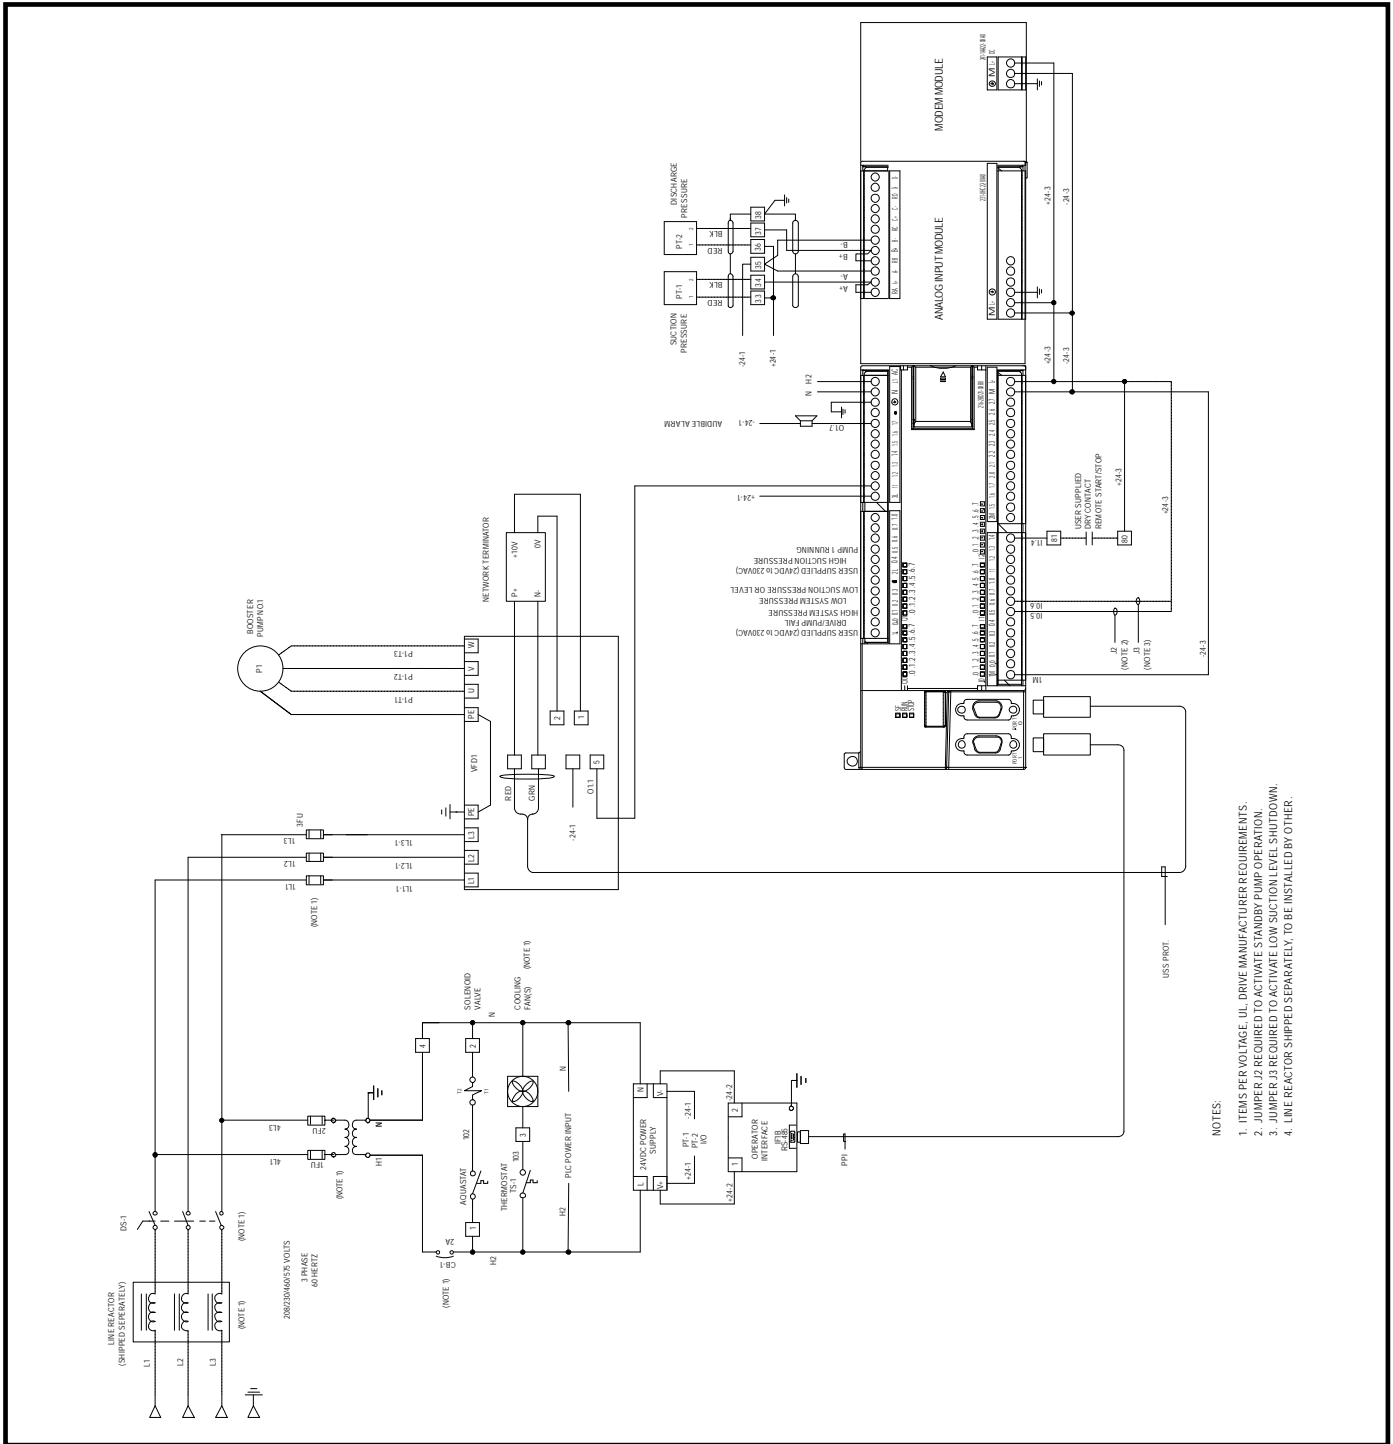

- NOTES:
1. ITEMS PER VOLTAGE. UL DRIVE MANUFACTURER REQUIREMENTS.
 2. JUMPER J2 REQUIRED TO ACTIVATE STANDBY PUMP OPERATION.
 3. JUMPER J3 REQUIRED TO ACTIVATE LOW SUCTION LEVEL SHUTDOWN.
 4. LINE REACTOR SHIPPED SEPARATELY TO BE INSTALLED BY OTHER.

S. A. Armstrong Limited
 23 Bertrand Avenue
 Toronto, Ontario
 Canada, M1L 2P3
 T: (416) 755-2291
 F (Main): (416) 759-9101

Armstrong Pumps Inc.
 93 East Avenue
 North Tonawanda, New York
 U.S.A. 14120-6594
 T: (716) 693-8813
 F: (716) 693-8970

Armstrong Holden Brooke Pullen
 Wenlock Way
 Manchester
 United Kingdom, M12 5JL
 T: +44 (0) 161 223 2223
 F: +44 (0) 161 220 9660